


# TRACT 180 MUTUAL WATER COMPANY 2025 CONSUMER CONFIDENCE REPORT

Since 1991, California water utilities have been providing information on water served to its consumers. This report, prepared May 2026, is a snapshot of the tap water quality that we provided last year. Included are details about where your water comes from, how it is tested, what is in it, and how it compares with state and federal limits. We strive to keep you informed about the quality of your water, and to provide a reliable and economic supply that meets all regulatory requirements.

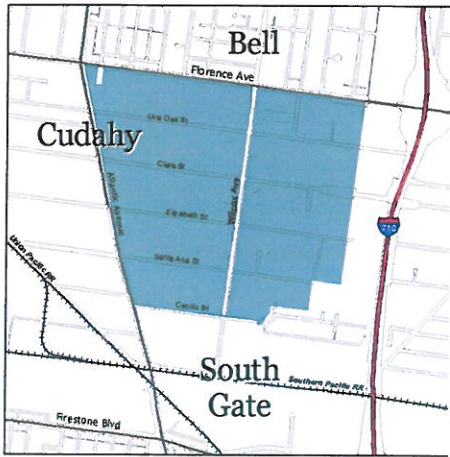

## **Where Does My Tap Water Come From?**

Your tap water comes from local, deep groundwater wells that supply our service area shown on the adjacent map. The quality of

groundwater delivered to your home is presented in this report.

## **How is My Drinking Water Tested?**

Your drinking water is tested regularly for unsafe levels of chemicals, radioactivity and bacteria at the source and in the distribution system. We test weekly, monthly, quarterly, annually or less often depending on the substance. State and federal laws allow us to test some substances less than once per year because their levels do not change frequently. All water quality tests are conducted by specially trained technicians in state-certified laboratories.

## **What Are Drinking Water Standards?**

The U.S Environmental Protection Agency (USEPA) limits the amount of certain substances allowed in tap water. In California, the State Water Resources Control Board (State Water Board) regulates tap water quality by enforcing limits that are at least as stringent as the USEPA's. Historically, California limits are more stringent than the Federal ones.

There are two types of these limits, known as standards. Primary standards protect you from substances that could potentially affect your health. Secondary standards regulate substances that affect the aesthetic qualities of water. Regulations set a Maximum Contaminant Level (MCL) for each of the primary and secondary standards. The MCL is the highest level of a substance that is allowed in your drinking water.

Public Health Goals (PHGs) are set by the California Environmental Protection Agency. PHGs provide more information on the quality of drinking water to customers, and are similar to their federal counterparts, Maximum Contaminant Level Goals (MCLGs). PHGs and MCLGs are advisory levels that are non-enforceable. Both PHGs and MCLGs are concentrations of a substance below which there are no known or expected health risks.

## **How Do I Read the Water Quality Table?**

Although we test for over 100 substances, regulations require us to report only those found in your water. The first column of the water quality table lists substances detected in your water. The next columns list the average concentration and range of concentrations found in your drinking water. Following are columns that list the MCL and PHG or MCLG, if appropriate. The last column describes the likely sources of these substances in drinking water.

To review the quality of your drinking water, compare the highest concentration and the MCL. Exceedence of a primary MCL does not usually constitute an immediate health threat. Rather, it requires testing the source water more frequently for a short duration. If test results show that the water continues to exceed the MCL, the water must be treated to remove the substance, or the source must be removed from service.

## **Why Do I See So Much Coverage in the News About the Quality Of Tap Water?**

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- Microbial contaminants, including viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife;
- Inorganic contaminants, such as salts and metals, that can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming;
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses;
- Organic chemical contaminants, including synthetic and volatile organic chemicals, that are byproducts of industrial processes and petroleum production, and

can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems;

- Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the USEPA and the State Water Resources Control Board (State Water Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline (1-800-426-4791). You can also get more information on tap water by logging on to these helpful web sites:

- <https://www.epa.gov/ground-water-and-drinking-water/safe-drinking-water-information>  
(USEPA's web site)
- [http://www.waterboards.ca.gov/drinking\\_water/certification/drinkingwater/NotificationLevels.shtml](http://www.waterboards.ca.gov/drinking_water/certification/drinkingwater/NotificationLevels.shtml)  
(State Water Board web site)

If present, elevated levels of lead can cause serious health problem, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Tract 180 Mutual Water Company is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your pipes for several minutes by running your tap, taking a shower, doing laundry or a load of dishes. You can also use a filter certified by an American National Standards Institute accredited certifier to reduce lead in drinking water" and include "If you are concerned about lead in your water and wish to have your water tested, contact Tract 180 Water Company at (323-771-6682). Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available at <http://www.epa.gov/safewater/lead>.

### **Should I Take Additional Precautions?**

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. The USEPA/Centers for Disease Control guidelines on appropriate means to lessen the risk of infection of *Cryptosporidium* and other microbial contaminants are

available from the USEPA's Safe Drinking Water Hotline (1-800-426-4791).

### **Source Water Assessment**

The Tract 180 Mutual Water Company conducted an assessment of its groundwater supplies in 2003. Groundwater supplies are considered most vulnerable to automobile gas stations, chemical/petroleum processing/storage, automobile repair shops, motor pools, and historic gas stations. A copy of the approved assessment may be obtained by written request to the office.

### **How Can I Participate in Decisions On Water Issues That Affect Me?**

The public is welcome to attend monthly Board Meetings on the fourth Monday of each month at 1:00 p.m. at 4544 Florence Avenue, Cudahy, CA 90201.

### **How Do I Contact My Water Agency If I Have Any Questions About Water Quality?**

If you have specific questions about your tap water quality, please contact Mr. George Perez at (323) 771-6682.

### **Some Helpful Water Conservation Tips**

- Fix leaky faucets in your home – save up to 20 gallons every day for every leak stopped
- Save between 15 and 50 gallons each time by only washing full loads of laundry
- Adjust your sprinklers so that water lands on your lawn/garden, not the sidewalk/driveway – save 500 gallons per month
- Use organic mulch around plants to reduce evaporation – save hundreds of gallons a year
- Turn off the water when you brush your teeth – save up to 3 gallons per day
- Use a water-efficient showerhead. They're inexpensive, easy to install, and can save you up to 750 gallons a month.
- Visit <http://www.epa.gov/watersense> for more information.

**Tract 180 Water Company Website:**

[www.tract180water.com](http://www.tract180water.com)

# TRACT 180 WATER COMPANY 2025 CONSUMER CONFIDENCE REPORT

Results are from the most recent testing performed in accordance with state and federal drinking water regulations  
The State allows monitoring for some contaminants less than once per year because the concentrations of these contaminants do not change frequently.  
Some of the data, though representative, are more than one year old

| <b>PRIMARY STANDARDS MONITORED AT THE SOURCE - MANDATED FOR PUBLIC HEALTH</b> |             |             |             |               |  |  |
|---|-------------|-------------|-------------|---------------|--|--|
| ORGANIC CHEMICALS (µg/l)  | GROUNDWATER |             | PRIMARY MCL | PHG or (MCLG) | MAJOR SOURCES IN DRINKING WATER  |  |
|   | AVERAGE     | RANGE       |             |               | Discharge from industrial chemical factories   | Discharge from factories, dry cleaners, and auto shops (metal degreaser) |
| 1,1-Dichloroethylene  | 0.08        | ND - 0.67   | 6           | 10 (a)        | Discharge from industrial chemical factories   |  |
| Tetrachloroethylene (PCE)   | 1.73        | 1.3 - 2.5   | 5           | 0.06 (a)      | Discharge from metal degreasing sites and other factories  |  |
| Trichloroethylene (TCE)   | 1.79        | 1.2 - 2.9   | 5           | 1.7 (e)       | Discharge from metal degreasing sites and other factories  |  |
| <b>INORGANICS</b>   |             |             |             |               |  |  |
| Sampled from 2023 to 2025   |             |             |             |               |  |  |
| Arsenic (µg/l)  | 1.05        | 1.4 - 2.1   | 10          | 0.004 (b)     | Erosion of natural deposits; glass/electronics production wastes; runoff   |  |
| Barium (mg/l)   | 0.13        | 0.13        | 1           | 2 (a)         | Oil drilling waste and metal refinery discharge; erosion of natural deposits   |  |
| Hexavalent Chromium (ug/l) (k)  | 0.48        | 0.31 - 0.81 | 10.0        | 0.02          | Discharge from electroplating factories, leather tanneries, wood preservation, chemical synthesis, refractory production, and textile manufacturing facilities; erosion of natural deposits. |  |
| Fluoride (mg/l)   | 0.30        | 0.30        | 2           | 1 (a)         | Erosion of natural deposits, water additive that promotes strong teeth   |  |
| Nitrate (mg/l as N)   | 1.4         | 1.2 - 1.9   | 10          | 10 (a)        | Runoff and leaching from fertilizer use/septic tanks/sewage, natural erosion   |  |
| Selenium (ug/l)   | 1.30        | ND - 2.6    | 50          | 30            | Discharge from petroleum, glass, and metal refineries; erosion of natural deposits; discharge from mines and chemical manufacturers; runoff from livestock lots. (feed additive)             |  |
| <b>RADIOLOGICAL - (pCi/l) (Results are from 2022 - 2025) (b)</b>              |             |             |             |               |  |  |
| Gross Alpha   | ND          | ND          | 15          | (0)           | Erosion of natural deposits  |  |
| Radium 226  | ND          | ND          | 5 (f)       | 0.05          | Erosion of natural deposits  |  |
| Radium 228  | ND          | ND          | 20          | 0.019         | Erosion of natural deposits  |  |
| Uranium   | 1.12        | 0.83 - 1.4  | 20          | 0.43 (a)      | Erosion of natural deposits  |  |

| <b>PRIMARY STANDARDS MONITORED IN THE DISTRIBUTION SYSTEM - MANDATED FOR PUBLIC HEALTH</b> |                     |                       |  |               |   |                               |
|--|---------------------|-----------------------|--|---------------|---|-------------------------------|
| MICROBIALS   | DISTRIBUTION SYSTEM |                       | PRIMARY MCL                            | PHG or (MCLG) | Other sources   |                               |
|  | AVERAGE # POSITIVE  | RANGE OF # POSITIVE   |  |               | Naturally present in the environment. Coliforms are bacteria that are naturally present in the environment and are used as an indicator that other, potentially-harmful, bacteria may be present. | Human and animal fecal waste. |
| Total Coliform Bacteria  | 0.0                 | 0                     | No more than 1 positive monthly sample | (0)           | Naturally present in the environment. Coliforms are bacteria that are naturally present in the environment and are used as an indicator that other, potentially-harmful, bacteria may be present. |                               |
| Fecal Coliform and E.Coli Bacteria   | 0                   | 0                     | 0                                      | (0)           | Human and animal fecal waste.   |                               |
| No. of Acute Violations  | 0                   | 0                     | -                                      | -             |   |                               |
| <b>MICROBIALS</b>  |                     |                       |  |               |   |                               |
| DISTRIBUTION SYSTEM  |                     |                       |  |               |   |                               |
| AVERAGE  | 0.4                 | RANGE                 | TT                                     | PHG or (MCLG) | Soil runoff   |                               |
| <b>DISINFECTION BY-PRODUCTS (c) AND DISINFECTION RESIDUALS</b>                             |                     |                       |  |               |   |                               |
| DISTRIBUTION SYSTEM  |                     |                       |  |               |   |                               |
| AVERAGE  | 6.1                 | RANGE                 | 80                                     | PHG or (MCLG) | By-product of drinking water chlorination   |                               |
| Total Trihalomethanes-TTHMs (µg/l)   | 0.4                 | 4.0 - 7.7             | 60                                     | -             | By-product of drinking water disinfection   |                               |
| Halocetic Acids (µg/l)   | 0.8                 | ND - 1.7              | 4.0 (d)                                | 4.0 (e)       | Drinking water disinfectant added for treatment   |                               |
| Total Chlorine Residual (mg/l)   |                     |                       |  |               |   |                               |
| <b>AT THE TAP</b>  |                     |                       |  |               |   |                               |
| DISTRIBUTION SYSTEM  |                     |                       |  |               |   |                               |
| 90th PERCENTILE LEVEL DETECTED   | 0.16 (f)            | NUMBER SITES ABOVE AL | 1.3 AL                                 | ACTION LEVEL  | PHG or (MCLG)   |                               |
| Copper (mg/l)  | ND (f)              | 0                     | 15 AL                                  | 0.3 (a)       | Internal corrosion of household plumbing, erosion of natural deposits, leaching from wood preservatives   |                               |
| Lead (µg/l)  | ND (f)              | 0                     | 15 AL                                  | 0.2 (a)       | Internal corrosion of household plumbing, industrial manufacturer discharges, erosion of natural deposits   |                               |

**SECONDARY STANDARDS MONITORED AT THE SOURCE-FOR AESTHETIC PURPOSES**

| Sampled in 2023-2025               | GROUNDWATER |             | SECONDARY MCL | PHG OR (MCLG)  |
|------------------------------------|-------------|-------------|---------------|--|
|                                    | AVERAGE     | RANGE       |               |  |
| Aggressiveness Index (corrosivity) | 12.0        | 11.5 - 12.4 | Non-corrosive | Natural/industrially-influenced balance of hydrogen/carbon/oxygen in water |
| Chloride (mg/l)                    | 50          | 48 - 52     | 500           | Runoff/leaching from natural deposits, seawater influence                  |
| Color (color units)                | ND          | ND          | 15 (h)        | Naturally-occurring organic materials                                      |
| Specific Conductance (uS/cm)       | 680         | 650 - 710   | 1,600         | Substances that form ions when in water, seawater influence                |
| Manganese (ug/l) (g)               | 0.93        | ND - 3.7    | 5             | Leaching from natural deposits.  |
| Odor (threshold odor number)       | ND          | ND          | 3             | Naturally-occurring organic materials                                      |
| Sulfate (mg/l)                     | 92.5        | 85 - 100    | 500           | Runoff/leaching from natural deposits, industrial wastes                   |
| Total Dissolved Solids (mg/l)      | 400         | 400.0       | 1,000         | Runoff/leaching from natural deposits                                      |
| Turbidity (NTU)                    | 0.15        | ND - 0.3    | 5             | Soil runoff  |

**SECONDARY STANDARDS MONITORED IN THE DISTRIBUTION SYSTEM-FOR AESTHETIC PURPOSES**

| GENERAL PHYSICAL CONSTITUENTS | DISTRIBUTION SYSTEM |       | SECONDARY MCL | PHG OR (MCLG)                         |
|-------------------------------|---------------------|-------|---------------|---------------------------------------|
|                               | AVERAGE             | RANGE |               |                                       |
| Color (color units)           | <3.0                | <3.0  | 15            | Naturally-occurring organic materials |
| Odor (threshold odor number)  | 1                   | 1     | 3             | Naturally-occurring organic materials |

**ADDITIONAL CHEMICALS OF INTEREST**

| GROUNDWATER                                |             |
|--|-------------|
| AVERAGE                                    | RANGE       |
| Total Alkalinity (mg/l)                    | 180 - 210   |
| Calcium (mg/l)                             | 65.7 - 66.8 |
| 1,4-Dioxane (ug/l) (i) - (Sampled in 2025) | 2.8         |
| Magnesium (mg/l)                           | 14.1 - 14.2 |
| pH (standard unit)                         | 7.4         |
| Potassium (mg/l)                           | 2.8 - 3.6   |
| Sodium (mg/l)                              | 49.0 - 52.0 |
| Total Hardness (mg/l)                      | 223 - 225   |

**FOOTNOTES**

- (a) California Public Health Goal (PHG). Other advisory levels listed in this column are Federal Maximum Contaminant Level Goals (MCLGs)
- (b) MCL compliance based on 4 consecutive quarters of sampling.
- (c) Running annual average used to calculate average, range, and MCL compliance.
- (d) Maximum Residual Disinfectant Level (MRDL)
- (e) Maximum Residual Disinfectant Level Goal (MRDLG)
- (f) 90th percentile from the most recent sampling at selected customer taps.
- (g) Secondary MCLs are set to protect the odor, taste, and appearance of drinking water
- (h) The color MCL is set to protect against unpleasant effects; an exceedance does not pose a health risk.
- (i) Combined Radium 226 + Radium 228 has a Maximum Contaminant Level (MCL) of 5 pCi/L.
- (j) The Notification Level of 1 ug/l for 1,4-Dioxane was exceeded in two wells in 2025. Some people who use water containing 1,4-dioxane in excess of the Notification Level over many years may experience liver or kidney problems and may have an increased risk of getting cancer, based on studies in laboratory animals.
- (k) Hexavalent Chromium (Cr-6) was detected in two wells in 2025. Pursuant to the Detection Limits for Purposes of Reporting (DLRs), the DLR for Hexavalent Chromium is 0.0001 mg/L or 0.1 ug/L. Tract 180 Mutual Water Company monitors for Hexavalent Chromium and has not exceeded the annual running average of 10 ug/l.
- (l) PFAS are a group of synthetic chemicals used in a wide range of consumer products and industrial applications including: non-stick cookware, water-repellent clothing, stain-resistant fabrics and carpets, cosmetics, firefighting foams, electroplating, and products that resist grease, water, and oil. PFAS are found in the blood of people and animals and in water, air, fish, and soil at locations across the United States and the world.

**PFAS: PER- and POLYFLUOROALKYL SUBSTANCES (I)**

|  | GROUNDWATER                     |          |
|--|---------------------------------|----------|
|  | AVERAGE                         | RANGE    |
| Sampled in 2025 - Analyzed by EPA Method 533 | Minimum Reporting Level = (MRL) |          |
| PERFLUOROOCTANE SULFONIC ACID (PFOS) (ng/l)  | 21.9                            | ND - 30  |
| NL=6.5 ng/l                                  | MRL=0.004 ug/l                  |          |
| PERFLUOROOCTANOIC ACID (PFOA) (ng/l)         | 7.3                             | ND - 11  |
| NL=5.1 ng/l                                  | MRL=0.004 ug/l                  |          |
| PERFLUOROHXANE SULFONIC ACID (PFHxS) (ng/l)  | 4.7                             | ND - 7.0 |
| NL=3 ng/l                                    | MRL=0.003 ug/l                  |          |
| PERFLUOROHXANOIC ACID (PFHxA) (ng/l)         | 2.7                             | ND - 3.8 |
| MRL=0.003 ug/l                               |                                 |          |
| PERFLUOROHPTANOIC ACID (PFHPA) (ng/l)        | 1.6                             | ND - 2.3 |
| MRL=0.003                                    |                                 |          |

**ABBREVIATIONS**

- mg/l = milligrams per liter or parts per million (equivalent to 1 drop in 42 gallons)
- ng/l = nanograms per liter or parts per trillion (equivalent to 1 drop in 42,000,000 gallons)
- ug/l = micrograms per liter or parts per billion (equivalent to 1 drop in 42,000 gallons)

**Notification of PFOA/PFOS:** PFOA and PFOS are manmade fluorinated organic chemicals that are part of a larger group of chemicals referred to as per- and poly-fluoroalkyl substances (PFASs). These substances have been synthesized for water and lipid resistance and have been used extensively in consumer products such as carpets, clothing, fabrics for furniture, paper packaging for food, and other materials (e.g., cookware) designed to be waterproof, stain-resistant or non-stick. In addition, they have been used in fire-retarding foam and various industrial processes. The U.S. EPA has not established enforceable drinking water standards, called maximum contaminant levels, for these chemicals.

In May 2016, the United States Environmental Protection Agency (U.S. EPA) issued a lifetime health advisory for PFOS and PFOA for drinking water, advising municipalities that they should notify their customers of the presence of levels over 70 parts per trillion (PPT) or nanograms per liter (NG/l) in community water supplies. In August 2019, State Water Resources Control Board, Division of Drinking Water (DDW), revised the notification levels to 6.5 ppt for PFOS and 5.1 ppt for PFOA. The single health advisory response level for the combined values of PFOS and PFOA remained at 70 ppt. Perfluorobutane sulfonic acid (PFBS) has a notification level of 500 ng/L (ppt). PFHxS - Perfluorohexane Sulfonic Acid is part of the group of Perfluorochemicals (PFCs). On February 6, 2020, DDW issued updated drinking water response levels of 10 ppt for PFOA and 40 ppt for PFOS based on a running four-quarter average. Exposure to PFOA and PFOS over certain levels may result in adverse health effects, including developmental effects to fetuses during pregnancy or to breastfed infants (e.g., low birth weight, accelerated puberty, skeletal variations), cancer (e.g., testicular, kidney, liver effects (e.g., tissue damage), immune effects (e.g., antibody production and immunity), thyroid effects and other effects (e.g., cholesterol changes). PFHxS - Perfluorohexane Sulfonic Acid is part of the group of Perfluorochemicals (PFCs). PFHxS, PFOS and PFOA share similar chemical structure and uses (i.e., surface treatment agents for textiles, paper, and furniture etc. for its excellent water-proofing and oil-resistance performance). PFHxS have been detected in endangered species and the human blood of the general population and the response level for PFHxS is 20 ng/L. For information on PFOA, PFOS, and other PFAS, including possible health outcomes, you may visit these websites: <https://www.epa.gov/pfas>.

- < = less than
- NA = constituent not analyzed
- ND = constituent not detected at the reporting limit
- uS/cm = microSiemens per centimeter
- pCi/L = picoCuries per liter
- NTU = nephelometric turbidity units

**DEFINITIONS**

**Maximum Contaminant Level (MCL):** The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

**Maximum Contaminant Level Goal (MCLG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency (USEPA).

**Maximum Residual Disinfectant Level (MRDL):** The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

**Maximum Residual Disinfectant Level Goal (MRDLG):** The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

**Notification Level:** The level at which notification of the public water system governing body is required. A health-based advisory level for an unregulated contaminant.

**Public Health Goal (PHG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

**Treatment Technique (TT):** A required process intended to reduce the level of a contaminant in drinking water.

**Regulatory Action Level (AL):** The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

**Primary Drinking Water Standard (PDWS):** MCLs, MRDLs and treatment techniques (TT) for contaminants that affect health, along with their monitoring and reporting requirements.

**Secondary Water Standard (SDWS):** MCLs and MRDLs for contaminants that affect taste, odor, or appearance of the drinking water. Contaminants with SDWSs do not affect the health at the MCL levels.

**Variations and Exemptions:** State Water Board permission to exceed an MCL or not comply with a TT under certain conditions.

**UNREGULATED CONTAMINANT MONITORING REGULATION (UCMR-5)**

The Safe Drinking Water Act requires the Environmental Protection Agency (EPA) to identify unregulated contaminants for potential regulations. Every five years, EPA identifies a list of unregulated contaminants to be monitored for by the nation's water utilities over a three year period. This is occurring in 2023-2025 with the Fifth UCMR (UCMR-5). **In 2024, Tract 180 Mutual Water Company began monitoring for a total of 30 chemical contaminants from its wells along with a corresponding sampling from the distribution system reflecting water from each well.** Once EPA has obtained this occurrence data nationally, they are required to determine if there is a meaningful opportunity for increased health protection of drinking water by regulating these contaminants. The findings from this monitoring are reported in this year's Consumer Confidence Report.

**FIFTH UNREGULATED CONTAMINANT MONITORING REGULATION (UCMR5)**

Monitored in 2024

| CHEMICALS PARAMETERS                 | AVERAGE | RANGE           | MINIMUM               |        | ADDITIONAL INFORMATION   |
|--------------------------------------|---------|-----------------|-----------------------|--------|--|
|                                      |         |                 | REPORTING LEVEL (MRL) | (ug/L) |  |
| perfluorohexanoic (PFHXA)            | 0.0008  | ND - 0.0031     | 0.003                 |        | PFAS are a group of synthetic chemicals used in a wide range of consumer products and industrial applications including: non-stick cookware, water-repellent clothing, stain-resistant fabrics and carpets, cosmetics, firefighting foams, electroplating, and products that resist grease, water, and oil. PFAS are found in the blood of people and animals and in water, air, fish, and soil at locations across the United States and the world. |
| perfluorohexanesulfonic acid (PFHXS) | 0.0049  | 0.0045 - 0.0059 | 0.003                 |        |  |
| perfluorooctanoic acid (PFOA)        | 0.0062  | 0.0058 - 0.0065 | 0.004                 |        |  |
| perfluorooctanesulfonic acid (PFOS)  | 0.0223  | 0.021 - 0.024   | 0.004                 |        |  |



- del desagüe pluvial, industrial, o de alcantarillado, producción de gas natural y petróleo, minas y agricultura.
- Pesticidas y herbicidas, los cuales pueden venir de varias fuentes tales como la agricultura, del desagüe pluvial, y de usos residenciales;
- Contaminantes de otras sustancias químicas orgánicas, incluyendo químicos orgánicos volátiles y sintéticos que son productos de procesos industriales y de la producción de petróleo, y que pueden provenir de las estaciones de gasolina, desagües pluviales urbanos, y agricultura aplicación y de sistemas sépticos;
- Contaminantes radioactivos, los cuales pueden ocurrir naturalmente o que pueden ser resultados de las actividades de la producción de gas natural y minería.

Con el fin de garantizar que el agua del grifo es segura para beber, la USEPA y la Junta de Control de Recursos Hídricos del Estado (Consejo de Estado) prescriben regulaciones que limitan la cantidad de ciertos contaminantes en el agua suministrada por los sistemas públicos de agua. Las regulaciones de la Administración de Alimentos y Medicamentos de Estados Unidos y la ley de California también establecen límites para los contaminantes en el agua embotellada que brindan la misma protección para la salud pública.

Toda el agua potable, incluyendo el agua embotellada, puede contener cantidades pequeñas de ciertos contaminantes. La presencia de contaminantes no necesariamente indica que haya algún riesgo de salud. Para más información acerca de contaminantes y riesgos a la salud favor de llamar a la USEPA encargada de proteger el agua potable al teléfono (1-800-426-4791). Usted puede obtener más información sobre el agua potable al conectarse al Internet en los siguientes domicilios:

- <https://www.epa.gov/ground-water-and-drinking-water/safe-drinking-water-information>  
(el sitio Web del USEPA)
- [http://www.waterboards.ca.gov/drinking\\_water/certification/NotificationLevels.shtml](http://www.waterboards.ca.gov/drinking_water/certification/NotificationLevels.shtml)  
(sitio Web de Bordo Estatal)

La presencia de niveles elevados de plomo puede causar problemas de salud graves, especialmente en mujeres embarazadas y niños pequeños. El plomo en el agua potable proviene principalmente de materiales y componentes asociados con las líneas de servicio y la plomería doméstica. Tract 180 Mutual Water Company es responsable de suministrar agua potable de alta calidad, pero no puede controlar la variedad de materiales utilizados en los componentes de plomería. Cuando el agua ha permanecido estancada en las tuberías durante varias horas, usted puede minimizar el riesgo de exposición al plomo dejando correr el agua durante unos minutos (ya sea abriendo el grifo, duchándose, lavando la ropa o poniendo el lavavajillas). También puede utilizar un filtro certificado por una entidad acreditada por el American National Standards Institute (ANSI) para reducir el contenido de plomo en el agua potable. Si le preocupa la presencia de plomo en su agua y desea realizar un análisis, comuníquese con Tract 180 Water Company al (323) 771-6682. Encontrará información sobre el plomo en el agua potable, los métodos de análisis y las medidas que puede tomar para minimizar la exposición en <http://www.epa.gov/safewater/lead>.

### ¿Debería Tomar Otras Precauciones?

Algunas personas pueden ser más vulnerables a los contaminantes en el agua potable que el público en general. Las personas que tienen problemas inmunológicos, o sea esas personas que estén en tratamiento por medio de quimioterapia cancerosa; personas que tienen órganos transplantados, o personas con SIDA o desordenes inmunológicos, personas de edad avanzada, y los bebés que son particularmente susceptibles a ciertas infecciones. Estas personas deben de consultar a sus proveedores de salud médica. Las guías de la USEPA/Centros de Control de Enfermedades aconsejan cómo disminuir los riesgos para prevenir la infección de Cryptosporidium y otros contaminantes microbiales están disponibles por teléfono de la USEPA encargada de proteger el agua potable al teléfono (1-800-426-4791).

### Valoración de su Abastecimiento de Agua

La Compañía De Agua De Tract 180 condujo una valoración de su abastecimiento de aguas subterráneas en el 2003. El abastecimiento de aguas subterráneas es considerado más vulnerable a estaciones de gasolina; a químicos, procesos petroleros, y almacenaje; a talleres automotrices; a estacionamientos; y a estaciones históricas de gasolina. Una copia de la valoración aprobada puede ser obtenida por participio pasado petición a la oficina.

### ¿Cómo Puedo Participar en las Decisiones Sobre Asuntos Acerca del Agua Que Me Puedan Afectar ?

El público puede asistir a las reuniones mensuales de la Junta el cuarto lunes de cada mes a la 1:00 p. m. en 4544 Florence Avenue, Cudahy, CA 90201.

### ¿Cómo Me Pongo En Contacto Con Mi Agencia del Agua Si Tengo Preguntas Sobre La Calidad Del Agua?

Si usted tiene preguntas específicas sobre la calidad del agua potable, por favor llame a Luis Rodriguez a (323) 771-6682.

### Algunas extremidades provechosas de la conservación del agua

Los · Fijan grifos agujereados en su casa – salvan hasta 20 galones cada día de cada agujero parado

Los · Ahorran entre 15 y 50 galones cada vez por sólo lavando cargas máximas del lavado de ropa

Los · Ajustan sus aspersores de modo que tierras de echar agua en su césped/jardín, no la acera/calzada – salven 500 galones por mes

Los · Usan el pajote orgánico alrededor de plantas para reducir la evaporación – salvan cientos de galones un año


Los · Apagan el echar agua cuando usted cepilla sus dientes – salvan hasta 3 galones por día

Los - Utilice un cabezal de ducha eficiente en agua. Son económicos, fáciles de instalar y pueden ahorrarle hasta 750 galones por mes.

Los - Visite <http://www.epa.gov/watersense> para obtener más información.

Sitio web de la compañía de agua Tract 180:

[www.tract180water.com](http://www.tract180water.com)

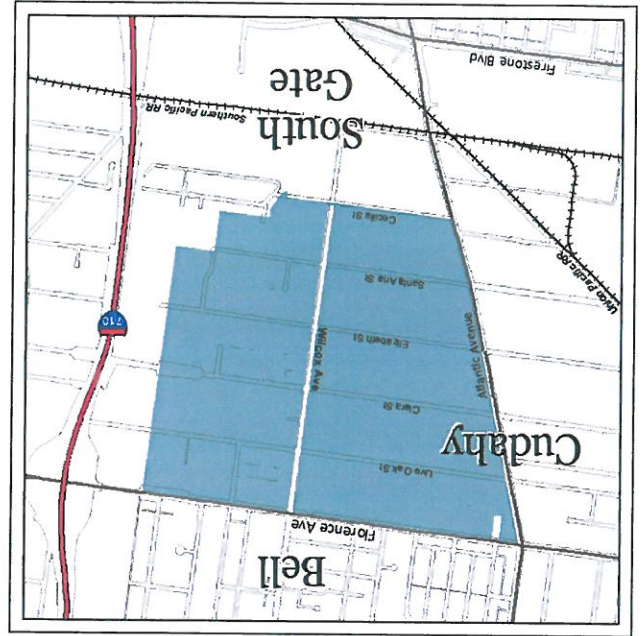

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien. Para obtener una copia en Español, llame a (323) 771-6682.

BOARD OF DIRECTORS

- GEORGE PEREZ - PRESIDENT
- LUIS GUTIERREZ- VICE PRESIDENT
- JESUS CARRERA - SECRETARY
- ABEL GONZALEZ - TREASURER
- LENORA WINGER - BOARD MEMBER

TRACT 180 MUTUAL WATER COMPANY  
 4544 FLORENCE AVENUE  
 CUDAHY, CALIFORNIA 90201